




- 1. CONDUIT SEAL NOT REQUIRED FOR FACTORY SEALED DEVICES "UL" RATED FOR CLASS I, DIVISION II INSTALLATIONS.
- 2. GROUND SCREW FOR INSTRUMENT WIRING IF REQUIRED.
- 3. SEE LOOP DETAIL FOR PROPER INSTALLATION.
- 4. USE SNAP TRACK CABLE CLAMPS TO SECURE CABLES.
- 5. USE SNAP TRACK COVER IF LESS THAN 3' ABOVE WORKING SURFACE. TRAY TO BE COVERED FOR 3' MINIMUM.
- 6. SEE DWG#: STC-DET-0001 FOR TYPICAL SNAP TRACK INSTALLATION.
- 7. NOMINAL DISTANCE OF 18", 36" MAXIMUM.

BILL OF MATERIALS

ITEM	QTY	DESCRIPTION
1	1	1/2" CONDUIT OUTLET BOX W/ INTERNAL MOUNTED 6PT TERMINAL BLOCK
2	1	1/2" CONDUIT UNION - MALE/FEMALE
3	1	1/2" CONDUIT NIPPLE
4	AS REQ'D	1/2" LIQUID TIGHT FLEXIBLE CONDUIT
5	2	CONDUIT NIPPLE
6	AS REQ'D	STC-2-2-AL-V2 - SNAP TRACK CABLE TRAY - 2" X 2" X 20'L - ALUMINUM
7	AS REQ'D	STCV-2-AL - SNAP TRACK COVER - 2" X 10'L - ALUMINUM
8	1	STCOS-2-2-AL SNAP TRACK CONDUIT OUTLET - 2" X 2" X 16"L - ALUMINUM
9	AS REQ'D	STWC-2-AL - SNAP TRACK 2" WIRE CLAMPS, RUBBER COATED W/ PUSHPIN

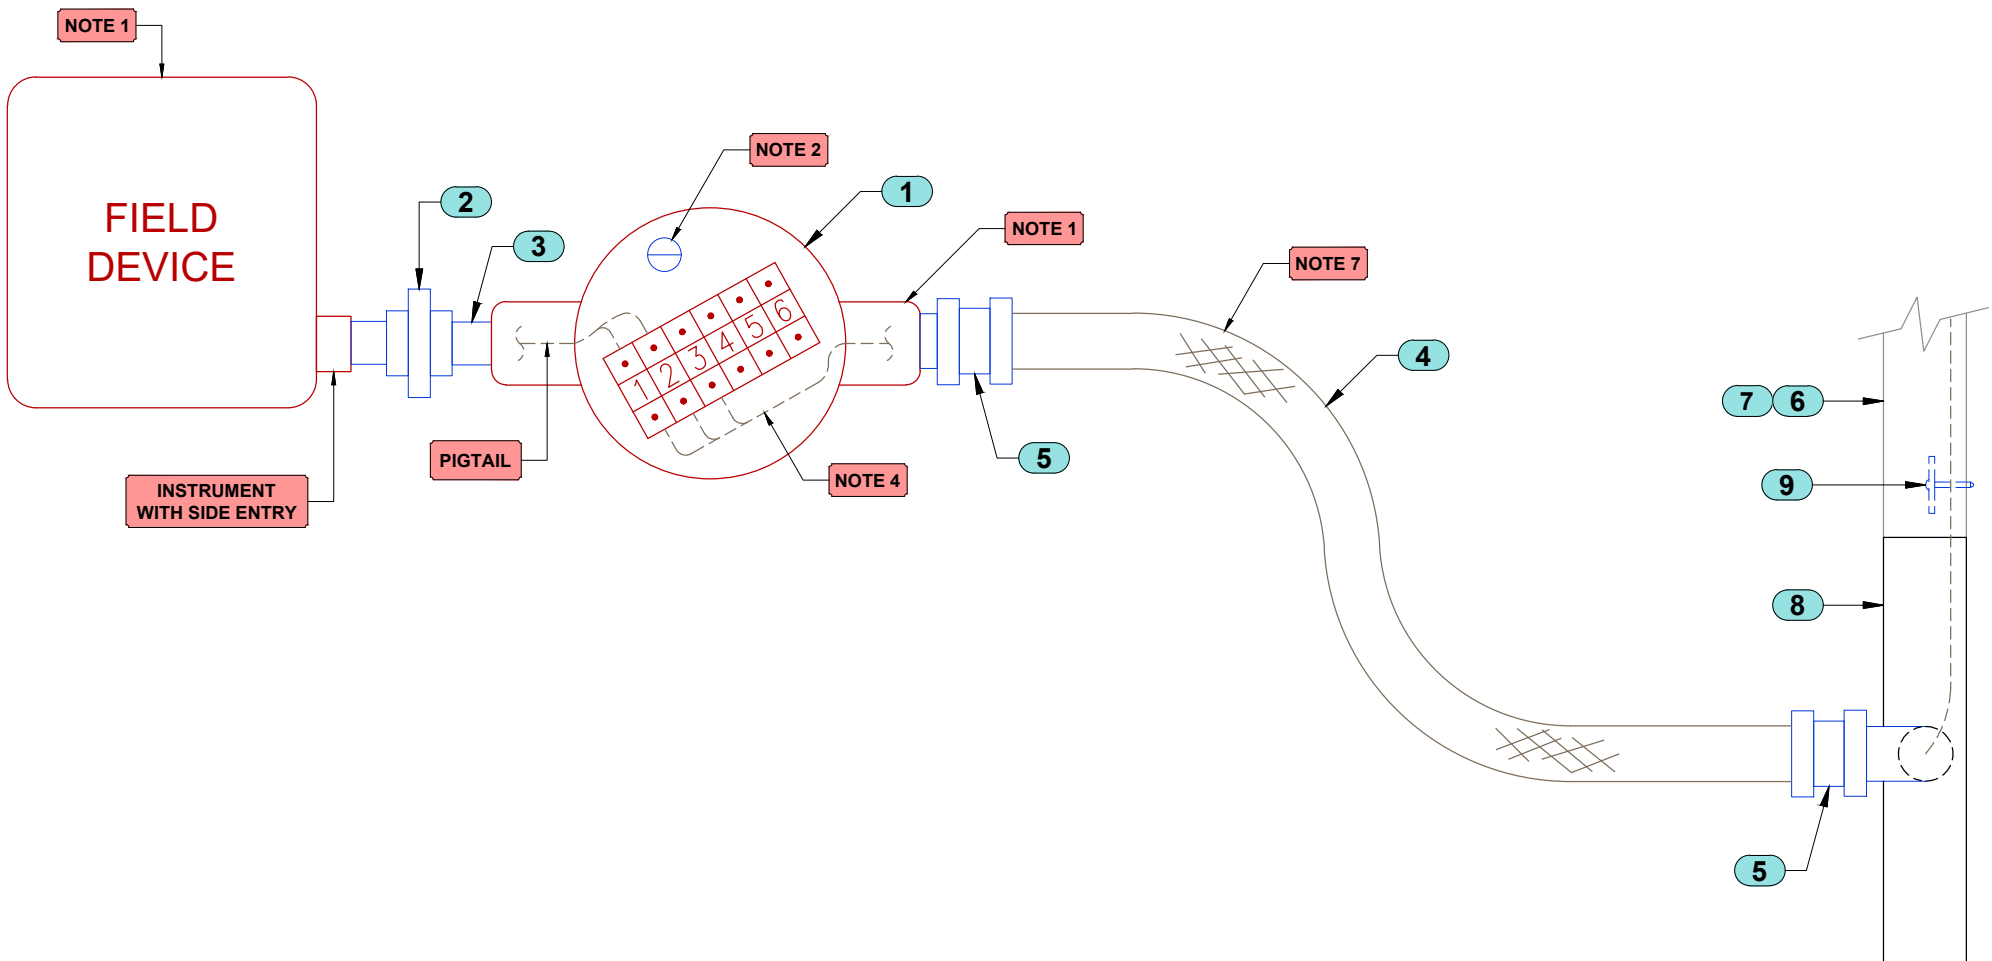