
| | |
|---|---|
| DRAWN BY: LSTJOHN | |
| DATE: 24 MAR 2026 | |
| DESCRIPTION: SAFETY SHOWER/EYE WASH STATION STANDARD INSTALLATION | |
| DWG #: STC-DET-0010.DWG | |

DIMENSIONS AND TOLERANCES ARE FOR MANUFACTURING PURPOSES ONLY. SUPPLIED COMPONENTS AND POST PRODUCTION TOLERANCES MAY VARY FROM THE MANUFACTURING AND PRODUCTION TOLERANCES DEFINED WITHIN THIS DOCUMENT.

TOLERANCES - ALL DIMENSIONS ARE IN INCHES
DIMENSIONS ARE IN ACCORDANCE WITH ASME Y14.5-2009
MANUFACTURING TOLERANCES UNLESS OTHERWISE SPECIFIED

| | | | |
|---|---|---|---|
| L | ± 0.125" | ∠ | ± 1° |
| W | ± 0.125" | ⌖ | ± 0.0625" |
| H | ± 0.125" | ∅ | ± 0.03125" |

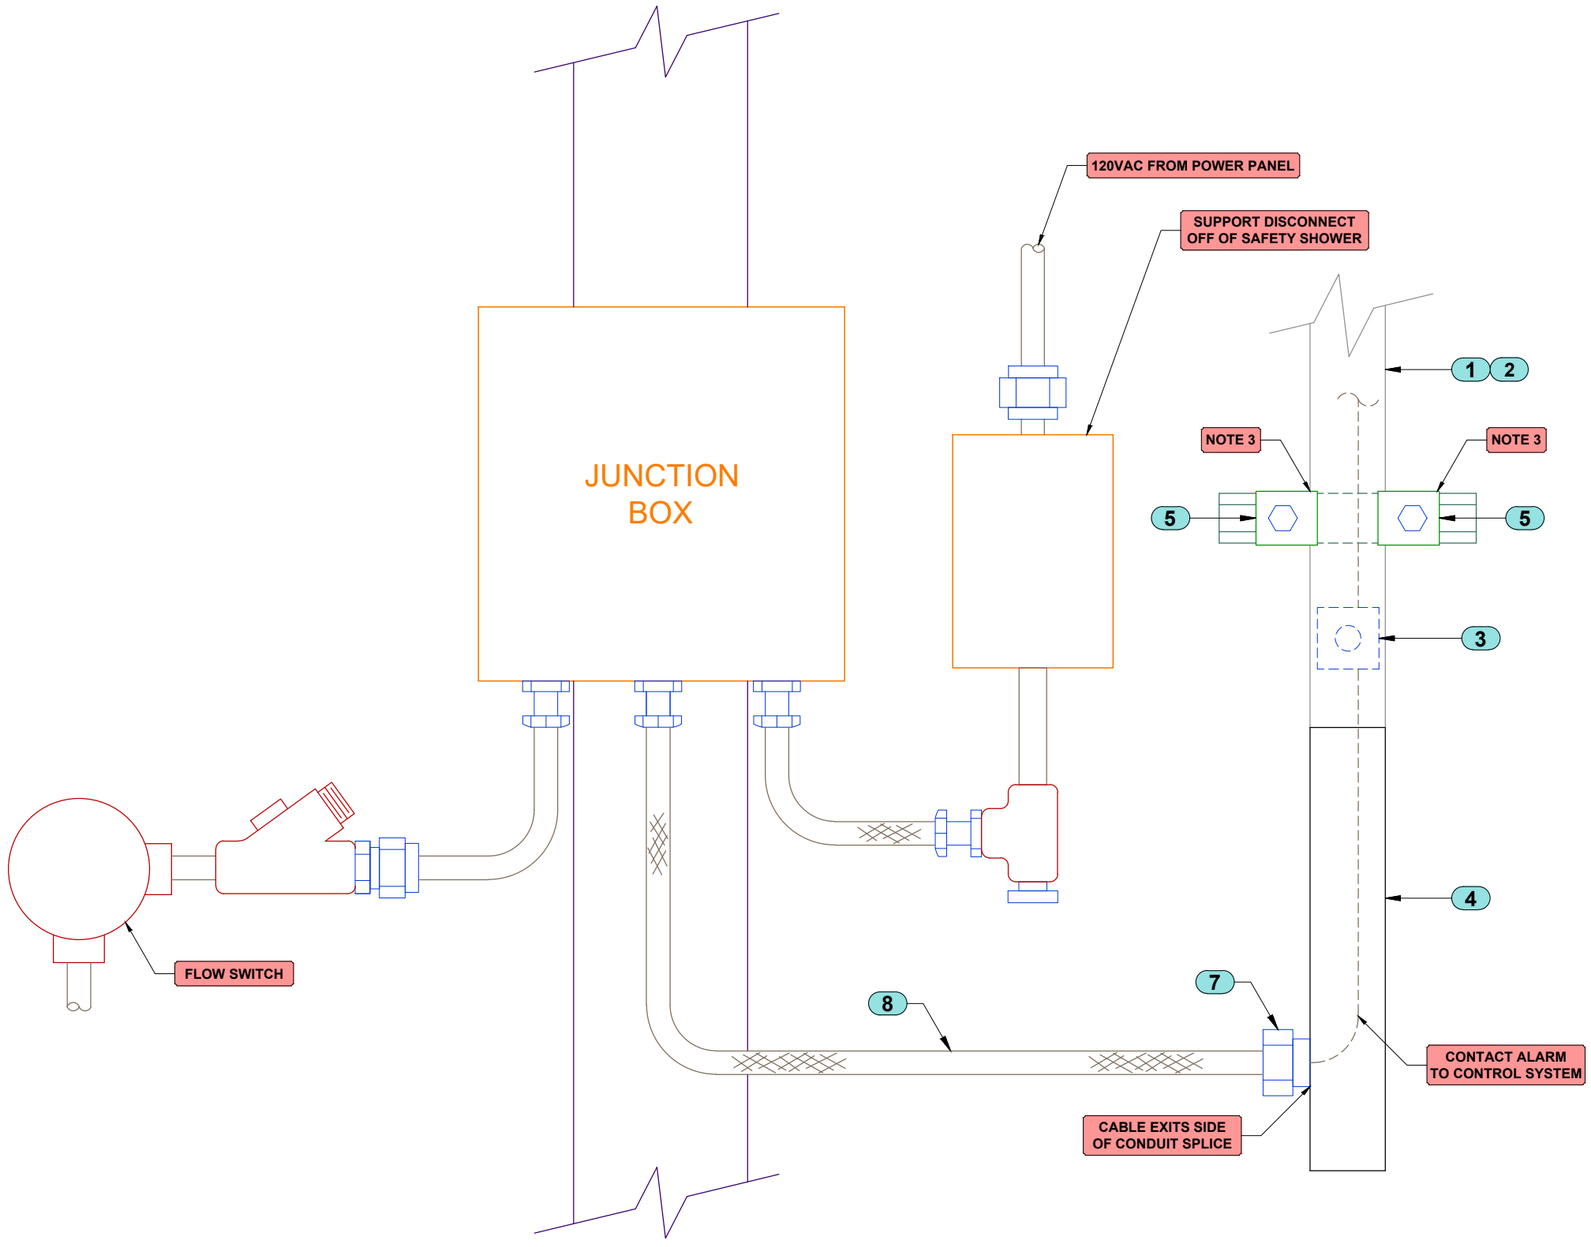


1. USE SNAPTRACK TRAY COVER ONLY IF LESS THAN 3' ABOVE WORKING SURFACE. TRAY SHOULD BE COVERED FOR 3' MINIMUM.
2. SNAPTRACK CABLE CLAMPS TO BE USED TO SECURE CABLES.
3. SNAPTRACK HOLD DOWN CLAMPS (STHC-2-AL) TO BE ATTACHED TO STRUT USING 1/2" SS BOLT, FLAT WASHER AND SPRING/STRUT NUT. ALSO CAN BE BOLTED THROUGH WITH A HEX NUT.

## BILL OF MATERIALS

| ITEM | QTY | DESCRIPTION |
|---|---|---|
| 1 | AS REQ'D | STC-2-2-AL-V2 - SNAP TRACK CABLE TRAY- 2" X 2" X 20'L - ALUMINUM |
| 2 | AS REQ'D | STCV-2-AL - SNAP TRACK COVER - 2" X 10'L - ALUMINUM |
| 3 | AS REQ'D | STWC-2-AL - SNAP TRACK 2" WIRE CLAMPS, RUBBER COATED W/ PUSHPIN |
| 4 | 1 | STCOS-2-2-AL - SNAP TRACK CHANNEL CONDUIT OUTLET SPLICE - 2" X 2" |
| 5 | AS REQ'D | STHC-2-AL - SNAP TRACK HOLD DOWN CLAMP - ALUMINUM |
| 6 | AS REQ'D | CONDUIT HUB, LIQUID TIGHT, WITH NUT AND GASKET, SIZE AS REQ'D |
| 7 | 2 | 1/2" LIQUID TIGHT CONNECTOR - MALE STRAIGHT |
| 8 | AS REQ'D | 1/2" LIQUID TIGHT FLEXIBLE CONDUIT |

The information, data, and drawings embodied in this document are strictly confidential and are supplied with the understanding that they will not be disclosed to third parties without the prior written consent of Techline Manufacturing. All information, illustrations, images, and data contained herein Copyright ©2025 TechLine Manufacturing.